


LINE DIAGRAM - SENSOR GRID CONNECTED FIXTURE w/Y-SPLITTER

DRIVERS

Follow manufacturer's guidelines for proper lamp wiring

ENLIGHTED PARTS

SENSOR UNIT	SU-5E	
CONTROL UNIT	CU-4E-FMH	
SPLITTER	CBL-CS-RJ45	
CABLE	CBL-5E-CU4-12N	= 12 IN
CABLE	CBL-5E-CU4-30N	= 30 IN
CABLE	CBL-5E-CU4-7F	= 7 FT

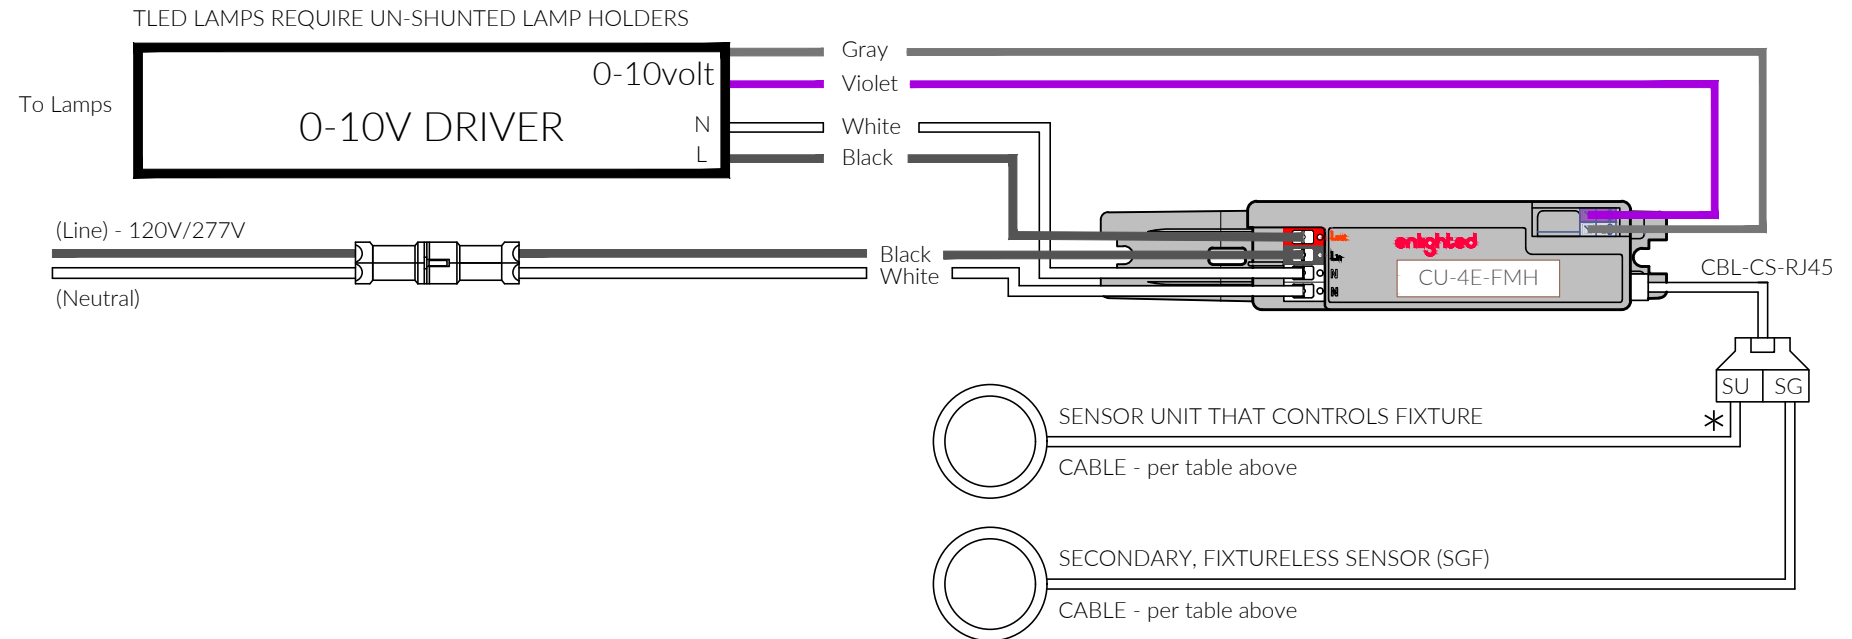

* CAUTION:

- Be certain that the sensor that is controlling the fixture is connected to the "SU" port of the splitter.
- The splitter is NOT plenum rated and must be installed inside of the fixture.



930 Benecia Ave
Sunnyvale, CA 94085
www.enlightedinc.com
855-874-1692

NOTE: Install in accordance with National and Local Electrical Codes in compliance with AHJ requirements

Rev # 93-02805-02